


Pipes should not be fixed but should be positioned in the hatch area

- Drainage waste water Ø110
- Drainage pipe Ø110 PE with hub and spigot joint
- connection drainage system
- Drainage clean water Ø50
- Earthing
- Electric supply 230V F+N 3kW
- Pipe Ø3/4" PE water supply
- drainage rain water Ø80

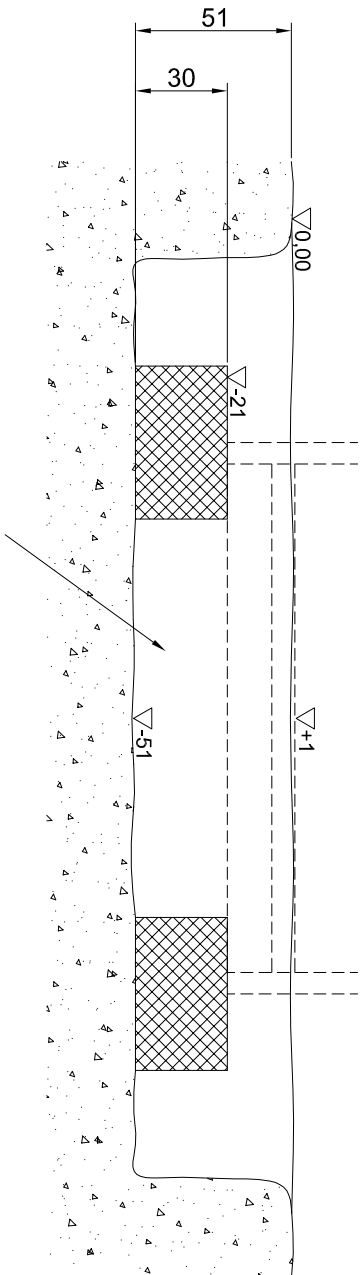

Pipes should not be fixed but should be positioned in the hatch area,after the backfilling, connections connections must be performed after installation of the unit

Keep the space between beams empty Sez. A-A

Rev. 1 Data 07/04/2015 | Nota:

CODIFICA DISEGNO:

95010.R1-Fondazione-CityHN.TCabbHN

OGGETTO:

FOUNDATION PLAN AND SECTION - CITY HN e TCAB HN

Materiale: C.A.V.

Note: PLANIMETRIA E SEZIONE

Tavola

Scala

1:25



Dis. da

L. Preti

Appr. da



PTMATIC S.r.l.  
Via Giotto, 1  
20010 Bereglio (MI)  
www.ptmatic.it